



PLAN

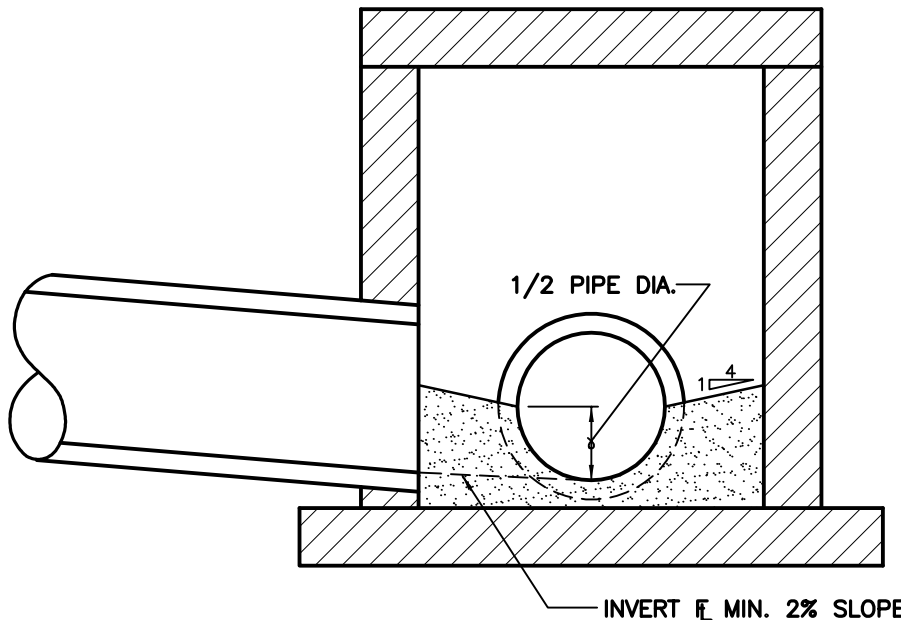

SECTION

NOTES:

1. FORM ALL INVERTS FOR SMOOTH FLOW THRU STRUCTURE.
2. INVERT SHALL BE FORMED UP TO 1/2 THE PIPE DIAMETER.
3. INVERT SHALL BE CLASS E CONCRETE.

 Approved	1/1/12 Date
	Revisions



DRAINAGE STRUCTURE INVERT

500.02